

Suppression of Class A Fires

**Mark L. Robin, Ph.D.
Fluorine Chemicals Department
Great Lakes Chemical Corporation
1801 Highway 52 NW
West Lafayette, IN 47906**

Presented at:

**1996 Halon Options Technical Working Conference
May 7-9, 1996
Sheraton Old Town
Albuquerque, NM**




Fire Suppression with Clean Agents

- **Vast majority (> 90%) of applications involve protection of Class A hazards**
 - ▶ **Electronic data processing (EDP) facilities**
 - ▶ **Telecommunication facilities**
- **Protection of Class B Hazards**
 - ▶ **represents only up to 10% of applications**
- **However, very little information available regarding the performance of clean agents on Class A fires**



T-Squared Fire Growth Curves

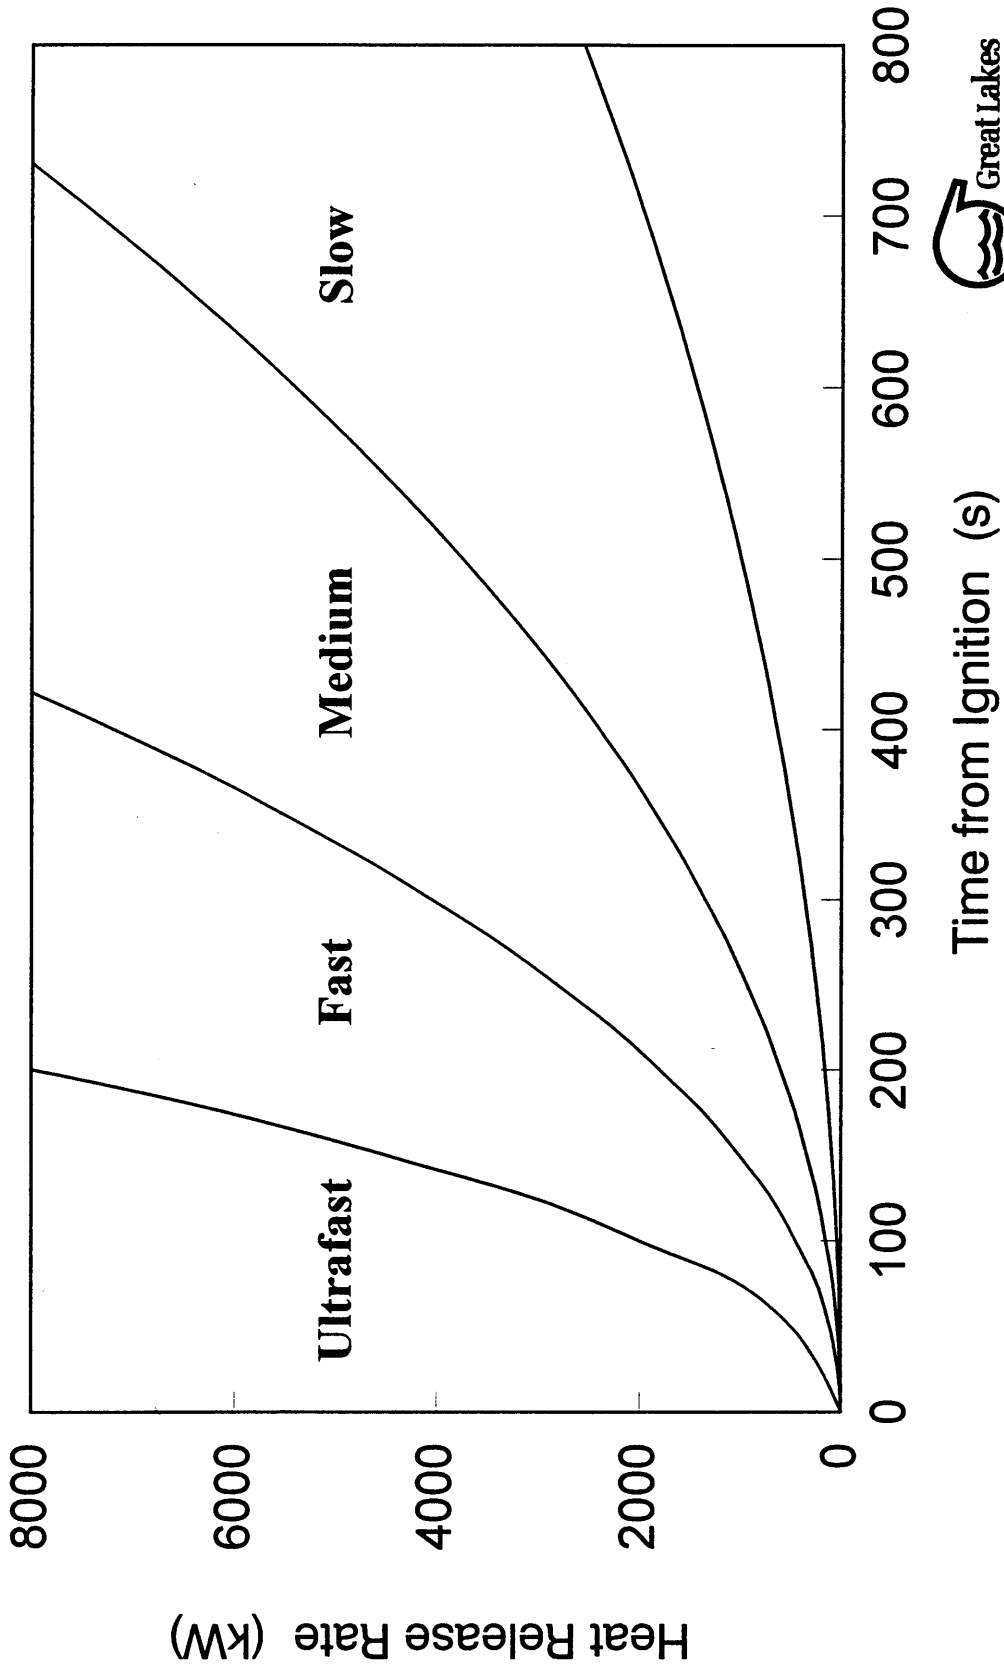

Class A Hazard Protection

- **Agent requirements for Class A protection linked to n-heptane requirements solely on an historical basis**
- **No technical justification for relating Class A requirements to Class B requirements**
 - ▶ **Class A: base agent requirements for Class A protection on testing of Class A materials**
 - ▶ **Class B: base agent requirements for Class B protection on testing of Class B materials (e.g., cup burner)**
- ▶ **Accepted by ISO TC 21/WG 8, Kyoto Spring 1996**



TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: HUGHES ASSOCIATES

- TEST FACILITY
 - ▶ 2,562 cu. ft.
 - ▶ Ionization Detection
 - ▶ 20' On-Center Detector Spacing

- INSTRUMENTATION
 - ▶ 3 Vertical Temperatures Trees
 - ▶ Pressure - Nozzle and Enclosure
 - ▶ Load Cell - Cylinder Mass
 - ▶ OD Meter - Smoke Production
 - ▶ Hydrogen Fluoride - in situ FTIR
 - ▶ Oxygen - Servomex 540A
 - ▶ Carbon Dioxide - Horiba 510
 - ▶ Carbon Monoxide - Rosemount 880A
 - ▶ Ionization detector - Simplex

TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: HUGHES ASSOCIATES

- TEST FIRES
 - ▶ Shredded Newsprint
 - ▶ Printed Circuit Boards
 - ▶ PVC Wire Bundles
 - ▶ Magnetic Tape

- EXPOSURE TARGETS
 - ▶ Relialogic ISA I/O cards
 - ▶ 30 Minute Exposure to Post-Suppression Atmosphere
 - ▶ Operation Check: Service Diagnostics, v. 2.13.18

- AGENT
 - ▶ 7% FM-200
 - ▶ 10 Second Discharge
 - ▶ 30 Second Delay Time



TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: SHREDDED NEWSPRINT

- **TEST FIRE**
 - ▶ 200 g Newsprint
 - ▶ Shredded Into 6 mm Strips, 30 to 61 cm in Length
 - ▶ Packed into Polyethylene Wastebasket
 - ▶ Ignite With Match on Top of Paper
 - ▶ Heat Release Rate 11 to 36 kW, 19 kW Average

- **SUPPRESSION**
 - ▶ All Test Fires Extinguished
 - ▶ Extinguishing Times 8 to 15 seconds

TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: PRINTED CIRCUIT BOARD FIRES

- **TEST FIRE**
 - ▶ 2 Zenith Data Systems 85-3334 boards
 - ▶ Vertically Mounted onto Frames 2.9 cm Apart
 - ▶ Ignition via Glo-Coil
 - ▶ Heat Release Rate 5 to 18 kW, 11 kW Average

- **SUPPRESSION**
 - ▶ All Test Fires Extinguished
 - ▶ Extinguishing Times 2 to 7 Seconds



TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: MAGNETIC TAPE FIRES

- TEST FIRE
 - ▶ 26.7 cm (10.5 in) Round Reel Tapes
 - ▶ Double Sided 120 Tape Rack Library
 - ▶ 4 Tapes per Row, 3 Rows High
 - ▶ Ignition via Glo-Coil
 - ▶ Heat Release Rate 21 to 35 kW, 23 kW Average

- SUPPRESSION
 - ▶ All Test Fires Extinguished
 - ▶ Extinguishing Times 6 to 11 Seconds



TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: PVC WIRE BUNDLE FIRES

- TEST FIRE
 - ▶ PVC Telephone Cable, 100 Pair
 - ▶ Ignition via 5.1 cm Square Pan of n-Heptane
 - ▶ Heat Release Rate 3 to 6 kW, 4 kW Average

- SUPPRESSION
 - ▶ All Test Fires Extinguished
 - ▶ Extinguishing Times 6 to 10 Seconds

EDP, Telecommunication Facilities

- **Low Fuel Load**
 - ▶ **Wire insulation**
 - ▶ **PC boards**
 - ▶ **Electronic components**
 - ▶ **Transformers**
 - ▶ **Insulating materials**
 - ▶ **Plastic housings**
- **Fires of Low Energy Output**
 - ▶ **often less than 5 to 10 kW**

B.J. Meacham, Fire Technology, First Quarter 1993, 35; L.A. McKenna, et. al. "In Situ Tests of Smoke Detection Systems" 1993.



TOTAL FLOODING APPLICATIONS

CLASS A HAZARDS: DECOMPOSITION PRODUCTS

Test Fire	FM-200 HF, ppm	Halon 1301 HF, ppm	Halon 1301 HBr, ppm
Shredded Newsprint	48 - 175	-	-
PC Boards	9 - 31	-	-
PVC Cable	37 - 58	37	not determined
Magnetic Tape	56 - 94	52	62

H1301 Data: C.L. Ford, Halon 1301 Computer Fire Test Program, Interim Report, January 10, 1972



TOTAL FLOODING APPLICATIONS


CLASS A HAZARDS: DECOMPOSITION PRODUCTS

Test Fire	FM-200 HF, ppm	Halon 1301 HF, ppm	Halon 1301 HBr, ppm
Shredded Newsprint	48 - 175	192	298
PC Boards	9 - 31	-	-
PVC Cable	37 - 58	-	-
Magnetic Tape	56 - 94	-	-

H1301 Data: R. Cholin, Fire Journal, Sept. 1972.



HAZARD ASSESSMENT OF HF CONCENTRATIONS

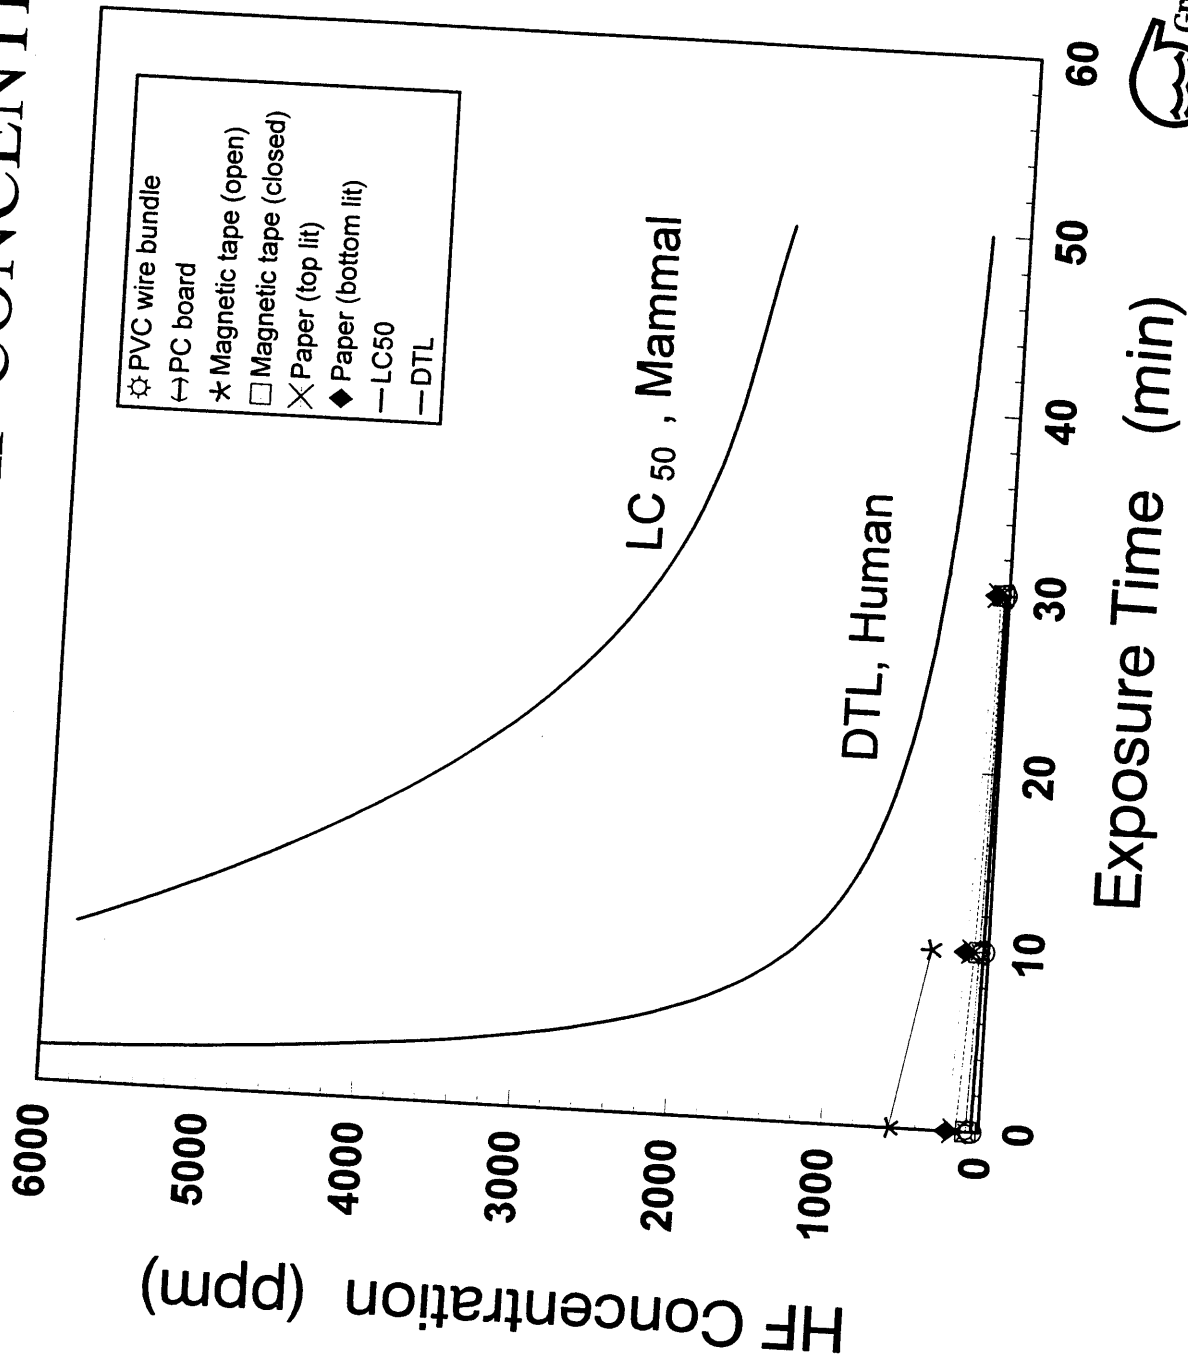

Halogen Acids: Damage to Equipment

- Decomposition Product Concentration
- Exposure Time
- Deposition Rate of Acids on Equipment Surfaces
- Relative Humidity
- Temperature
- Sensitivity of Equipment
- Combined Effects with Smoke



Halogen Acids: Damage to Equipment

Dumayas

- I/O Cards
- Six minute exposure
- 514 ppm HF
 - ▶ no failures
- 2126 ppm HF
 - ▶ no permanent damage
 - ▶ reinsertion required for some cards for operation

Hughes Associates, 1994.



Halogen Acids: Damage to Equipment

Ansul, duPont, Cardox, Fenwal

- PC boards, magnetic tape
- One hour exposure
- No damage for:
 - ▶ 294 ppm HF
 - ▶ 30 ppm HBr
 - ▶ 2425 ppm HCl

C.L. Ford, Halon 1301 Computer Test Program, 1972.

Halogen Acids: Damage to Equipment

Hughes Associates, Inc.

- I/O Cards
- 30 minute exposure
- No damage up to 1632 ppm HF (peak)

Hughes Associates, 1995.



Halogen Acids: Damage to Equipment

Pedley (NASA)

- Unpowered, powered electronics
- Nonmetallics, conformal coatings
- 4 hour exposures

- 50,000 ppm HF; 20,000 ppm HBr
 - ▶ all equipment failed

- 5,000 ppm HF; 2,000 ppm HBr
 - ▶ 50% of PC boards failed
 - ▶ coatings damaged

- 500 ppm HF; 500 ppm HBr
 - ▶ no damage to powered electronics
 - ▶ no damage to coatings


TR-339-001, NASA, 1985.




Heat Release Rates

Hazard	Heat Release Rate (kW)
USCG Tests	3,000 to 5,500
UL 1B Pan, n-heptane	460
UL "1058a" Crib	230
Newsprint, shredded	19
Magnetic Tapes	23
PC Boards	11
PVC Cables	4

HF CONCENTRATION: CLASS A AND CLASS B FIRES EXTINGUISHED WITH 7 - 8% FM-200

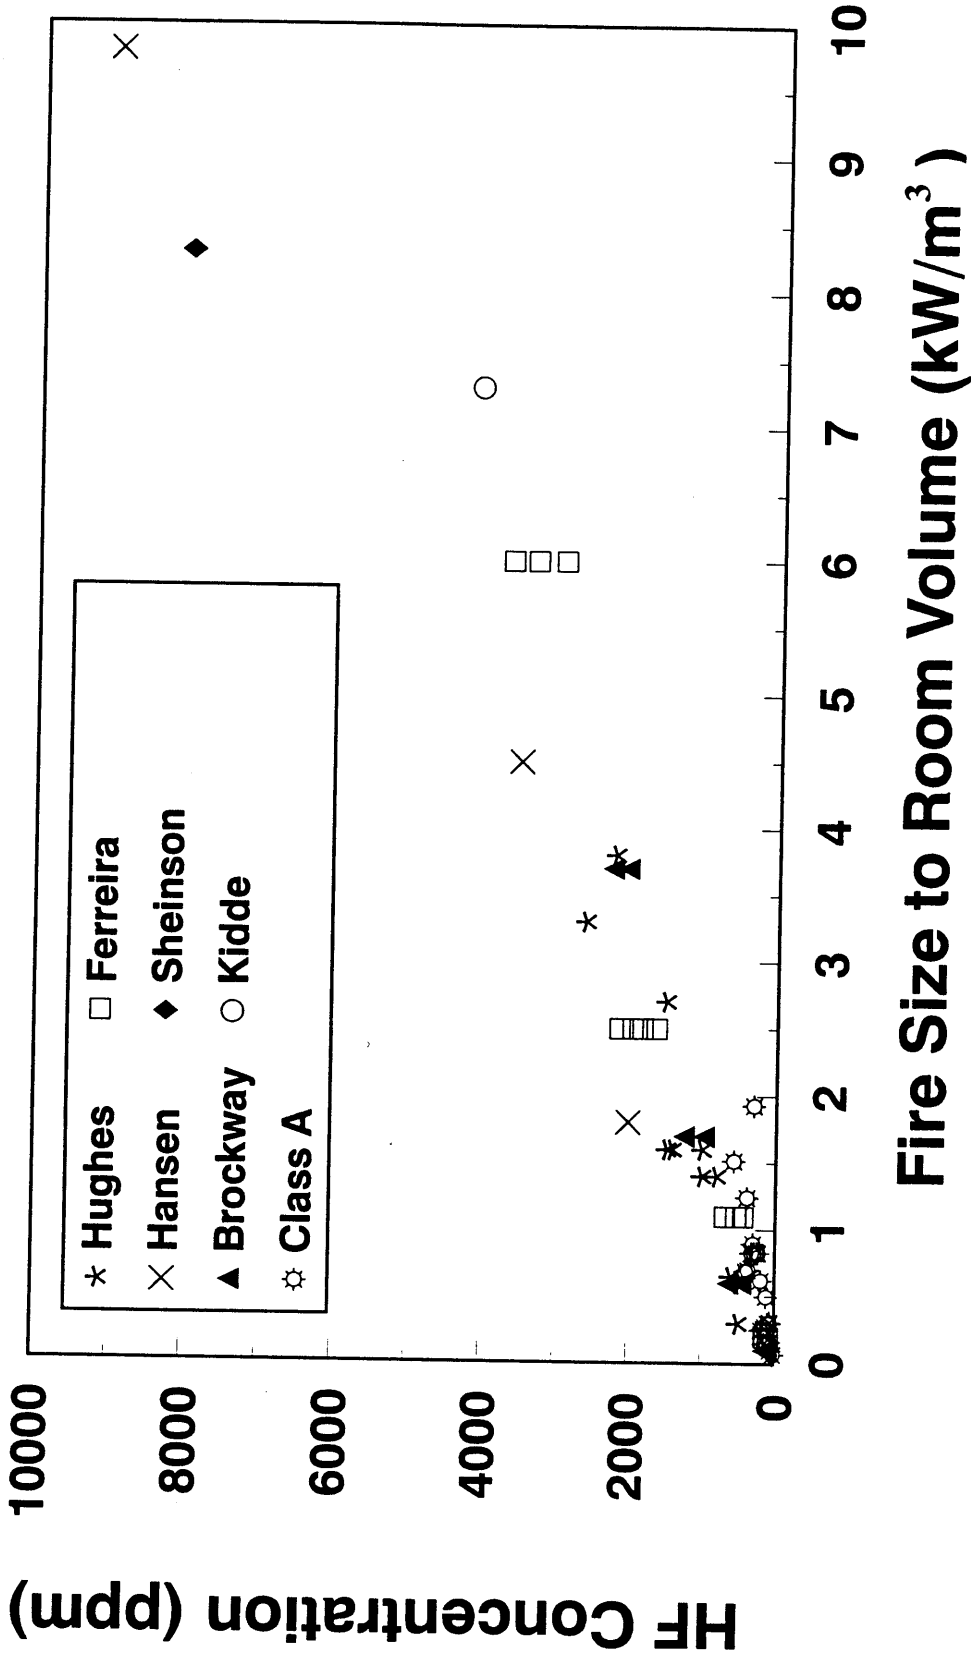

HF Concentration: Class A Fires Extinguished with 7 % v/v FM-200

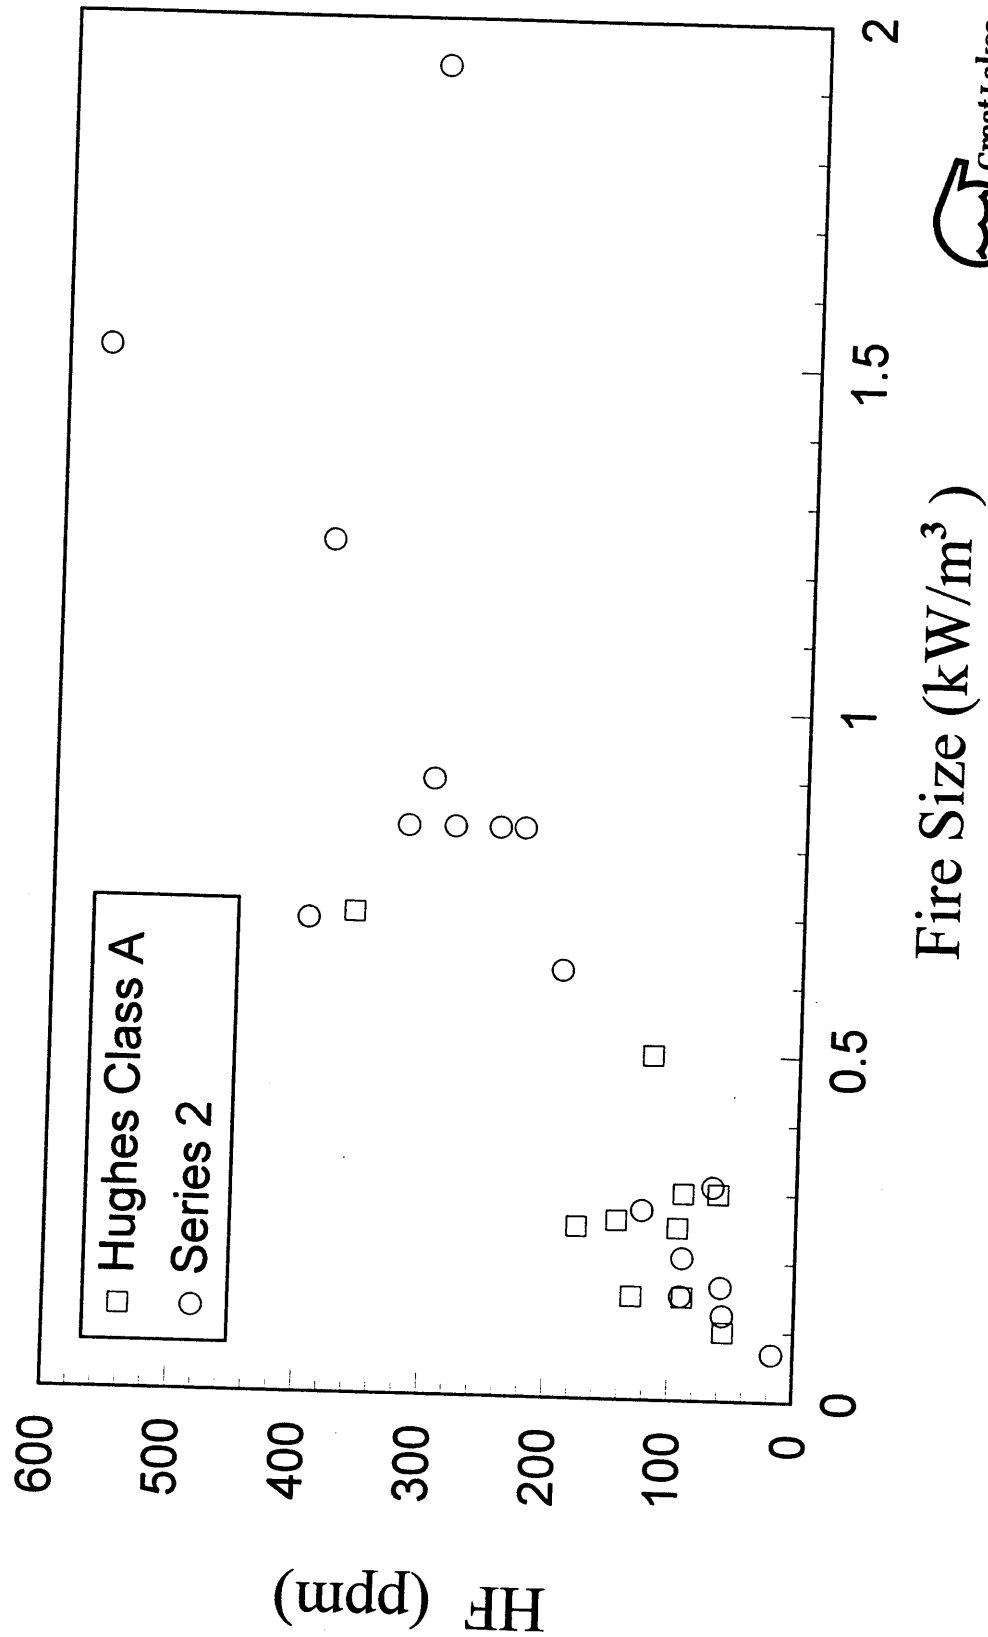

Summary

- **Over 90% of clean agent fire suppression applications involve the protection of Class A Hazards**
- **Fires in typical hazards (EDP, Telecommunication Facilities) are characterized by low fuel loadings and low energy output, often 5-10 kW**
- **For the extinguishment of Class A fires typical of those encountered in an EDP or telecommunications facility with 7% FM-200, the levels of HF produced were well below the estimated mammalian LC-50 and the human Dangerous Toxic Load (DTL).**
- **For the extinguishment of Class A fires typical of those encountered in an EDP or telecommunication facility, the levels of HF produced do not appear to present a threat to electronic equipment**